

(1)

Specification for

Unsintered PTFE tape. General requirements

Committees responsible for this British Standard

The preparation of this British Standard was entrusted to Technical Committee PSE/2, Jointing materials and compounds, upon which the following bodies were represented:

Asbestos Information Centre Ltd.
British Adhesives and Sealants Association
British Compressed Gases Association
British Hydromechanics Research Association
Energy Industries Council
Engineering Equipment and Materials Users' Association
Industrial Water Society
Institution of Water and Environmental Management
LP Gas Association
Water Services Association of England and Wales

This British Standard, having been prepared under the direction of the Engineering Sector Board, was published under the authority of the Standards Board and comes into effect on
15 June 1995

© BSI 1995

The following BSI references relate to the work on this standard:
Committee reference PSE/2
Draft for comment 93/707813 DC

ISBN 0 580 23622 6

Amendments issued since publication

Amd. No.	Date	Text affected

Contents

Committees responsible	Page Inside front cover
Foreword	ii
Specification	
1 Scope	1
2 References	1
3 Information and requirements to be agreed and documented	1
4 Composition	2
5 Appearance and finish	2
6 Tape grades	2
7 Tape dimensions	2
8 Thread wrapping	3
9 Sealing tests	3
10 Sampling	3
11 Packaging and marking	3
Annexes	
A (normative) Determination of residual lubricant content	4
B (informative) Explanatory note	4
C (normative) Determination of mass per unit area	7
D (normative) Measurement of tape dimensions	7
E (normative) Thread wrapping test	7
Table	
1 Tape grades	2
Figures	
B.1 Mass per unit area/density/thickness relationships	6
E.1 Thread wrapping test	7
List of references	Inside back cover

Foreword

This British Standard has been prepared under the direction of the Engineering Sector Board. It supersedes BS 4375 : 1968 which is withdrawn. BS 7786 specifies the material and general requirements for the complete range of unsintered polytetrafluoroethylene (PTFE) tapes suitable for most general and specialist engineering uses at temperatures up to 260 °C.

The requirements of this British Standard apply to all unsintered PTFE tapes. If the application is appropriate the requirements of BS 6974 : 1991 or other designated British, European or international standards may also apply.

WARNING. When heated to temperatures above 260 °C, PTFE will begin to degrade and the rate of degradation will increase with increasing temperature. The gases produced during degradation will vary according to the temperature and other conditions but will invariably contain toxic components. Where accidental or unavoidable exposure of PTFE to heat and/or flame occurs good ventilation is therefore essential.

This British Standard calls for the use of substances and/or procedures that may be injurious to health if adequate precautions are not taken. It refers only to the technical suitability and does not absolve the user from legal obligations relating to health and safety at any stage.

Compliance with a British Standard does not of itself confer immunity from legal obligations.

Specification

1 Scope

This British Standard specifies requirements for unsintered polytetrafluoroethylene (PTFE) tapes with a mass per unit area within the range 25 g/m² to 300 g/m² and with a thickness in the range 0.05 mm to 0.25 mm.

The general material requirements for three grades of unsintered PTFE tape are specified, for general or special engineering applications including tail stock sealing, thread sealing and/or as an antiseize agent at temperatures between - 270 °C and + 260 °C.

All grades of this tape are suitable for use with most common liquids and gases.

In addition to the definitive requirements, this standard also requires the items detailed in clause 3 to be documented. For compliance with this standard, both the definitive requirements and the documented items have to be satisfied.

2 References

2.1 Normative references

This British Standard incorporates, by dated or undated reference, provisions from other publications. These normative references are made at the appropriate places in the text and the cited publications are listed on the inside back cover. For dated references, only the edition cited applies; any subsequent amendments to or revisions of the cited publication apply to this British Standard only when incorporated in the reference by amendment or revision. For undated references, the latest edition of the cited publication applies, together with any amendments.

2.2 Informative references

This British Standard refers to other publications that provide information or guidance. Editions of these publications current at the time of issue of this standard are listed on the inside back cover, but reference should be made to the latest editions.

3 Information and requirements to be agreed and documented

3.1 Information to be supplied by the purchaser

The information to be supplied by the purchaser shall be fully documented. Both the definitive requirements specified throughout the standard and the following documented items shall be satisfied before a claim of compliance with the standard can be made and verified.

- a) The grade and thickness of tape chosen.
- b) The intended application for the PTFE tape, including any relevant British, European or international application Standards.

NOTE 1. Specific applications are covered in BS 6974 : 1991 and DIN 30660 : 1982.

- c) The maximum intended working pressure.

NOTE 2. The maximum working pressure will depend upon the grade and thickness of the tape, the method of application, the number of wraps, the size and quality of the fittings (threads) and the specific operating environment (flow product and temperature). In specialist applications, PTFE tapes have been satisfactorily used for sealing against pressures exceeding 300 bar¹⁾ and also for high vacuum applications.

- d) Whether the tape is to be used in oxygen-enriched environments.
- e) The length and width of tape chosen.
- f) Whether the tape is to be used in contact with, or likely to be used in contact with, potable water.

3.2 Items for agreement

The following items to be agreed between the contracting parties, which are specified in the clauses referred to, shall be fully documented. Both the definitive requirements specified throughout the standard and the following documented items shall be satisfied before a claim of compliance can be made.

- a) Where no specific application standard exists, that the grade, thickness and density chosen provides a safe leak-free joint and provides the agreed performance for the intended application (see clause 6, 7.3 and clause 9).

NOTE 1. For the purposes of product performance comparisons it may be desirable to select one of the preferred thickness values of 7.3.

- b) If the PTFE tape is to be used in oxygen-enriched environments, that the tape is suitable for this purpose (see 4.2).

NOTE 2. For applications involving either high concentrations or pressures (or both) of liquid or gaseous oxygen, either detonation or self-ignition tests (or both) may also be required. If in doubt it is essential that the user consult the oxygen supplier for guidance on these potential hazards.

- c) If the length differs from that normally supplied, the length supplied in this case (see 7.1).

- d) If the width differs from that normally supplied, the width supplied in this case (see 7.2).

- e) Where no specific application standard exists, the representative thread form used in a thread wrapping test (see 8.1).

- f) If the application requires test pressures which differ from those normally applied, the test pressure which will apply in this case (see clause 9).

NOTE 3. At the request of the user the manufacturer should provide sufficient information on the application and use of the tape together with any special measures or techniques which may be needed when the tape is being used under extremes of pressure, temperature or size.

¹⁾ 1 bar = 10⁵ N/m² = 100 kPa

4 Composition

4.1 The tape shall be manufactured from a suitable grade of coagulated dispersion PTFE powder which conforms to the designation C, P, Y, 220 given in BS 6564 : Section 1.2 : 1989. Filler, plasticizer, colour, reprocessed material, or additives other than processing lubricant shall not be added.

4.2 Where oxygen use is envisaged, the residual lubricant content shall not exceed 0.1 % (m/m). All tapes containing higher lubricant levels than 0.1 % (m/m) shall be marked as being unsuitable for oxygen use (see 11.2d). The residual lubricant level shall be determined by a solvent extraction method of the lubricant as described in annex A.

4.3 The conditions during manufacture shall be such that the tape remains in the unsintered state, as evidenced by the absence of a shift or change in peak height of the initial melting peak obtained by differential scanning calorimetry (DSC) when compared with the starting material. The melting endotherm temperature shall be between 340 °C and 350 °C (Code 8) when tested and designated according to ASTM D4591-93.

4.4 When used under the conditions for which they are designated, PTFE tapes in contact with, or likely to come into contact with, potable water shall conform to the requirements of BS 6920 : Part 1 : 1990.

NOTE 1. Non-metallic products for installation and use in the United Kingdom which are verified and listed under the UK Water Byelaws Scheme are deemed to satisfy the requirements of this subclause. Details of the Scheme are obtainable from the WRc Evaluation and Testing Centre, Fern Close, Pen-Y-Fan Industrial Estate, Oakdale, Gwent, NP1 4EH, telephone 01495 248454, fax 01495 249234.

In addition, products introduced in accordance with Regulation 25 of the Water Supply (Water Quality) Regulations, 1989 are considered free from adverse health effects for the purposes of conformance to this subclause.

NOTE 2. A list of substances and products approved under Regulation 25 can be obtained from the WRc Evaluation and Testing Centre, Fern Close, Pen-Y-Fan Industrial Estate, Oakdale, Gwent, NP1 4EH, telephone 01495 248454, fax 01495 249234.

5 Appearance and finish

5.1 When viewed in reflected light the tape shall be white in colour.

5.2 The tape shall be free from any edge or surface defects, inclusions, thin patches, tears and holes, when inspected visually.

6 Tape grades

NOTE. See annex B for explanatory note on tape grades.

6.1 Tape shall be supplied in one of the grades which are designated in terms of the mass per unit area and identified by the indicated grade letter as given in table 1.

Table 1. Tape grades

Grade	Mass/unit area g/m ²	Indicative applications ¹⁾
H	300 to 150	1 wrap up to R2 2 wraps R2 - R4 ²⁾ 3 wraps R4 - R6 ²⁾
M	150 to 75	1 wrap up to R3/4 or antiseize only up to R4 2 wraps R3/4 to R1 1/2 3 wraps R1 1/2 to R2
L	75 to 25	1 wrap up to R1/4 or antiseize only up to R2 2 wraps R1/4 to R1/2 3 wraps R1/2 to R1

¹⁾The indicative applications are not requirements but serve as a guide to the applications most suited to the tape. See also clause 3 for application limits.

²⁾For thread sizes larger than R4 the manufacturer should be consulted. For thread sizes larger than R2, if permitted, a non-penetrant lubricant applied to the surface of the wrapped tape is highly beneficial for reduction in tightening torque.

6.2 The mass per unit area shall not fall outside the range given for the grade and shall be determined in accordance with annex C.

NOTE. The mass per unit area in each category can be achieved by any combination of thickness and density commensurate with the appropriate range of values in each category.

7 Tape dimensions

7.1 Length

When determined in a tension free condition to an accuracy of ± 0.1 % in accordance with annex D, the actual length of tape on the spool shall be not less than that marked on the spool. Unless otherwise agreed in accordance with 3.2c, tape shall be supplied in lengths of 5 m, 10 m, 12 m or 25 m.

7.2 Width

When determined to an accuracy of ± 0.1 mm in accordance with annex D, the mean width of the tape, based on a minimum of five measurements taken at equal distances apart along the length of the tape, shall not differ from that marked on the spool by more than ± 0.5 mm. Unless otherwise agreed in accordance with 3.2d, tape shall be supplied in tape widths of 12 mm, 19 mm and 25 mm.

⑦

7.3 Thickness

When determined to an accuracy of 0.002 mm in accordance with annex D at an applied pressure of 10 kPa to 20 kPa, the mean thickness of the tape, based on a minimum of five readings taken at equal distances apart, shall not differ from the declared value by more than $\pm 10\%$. Unless otherwise agreed in accordance with 3.2a, or required by the manufacturer to ensure specified performance levels, tape shall be supplied in the following thicknesses: 0.075 mm; 0.1 mm; 0.2 mm (see clause 6).

NOTE. It may not be possible within the constraints of the grading system to supply all three preferred thicknesses at each grade. Some of the preferred thicknesses may be mutually exclusive to one or other of the grades.

8 Thread wrapping

8.1 All grades of tape shall be suitable for thread wrapping in accordance with annex E. Where no specific application standard exists a thread wrapping test shall be carried out on a representative thread form agreed in accordance with 3.2e.

8.2 When tested in accordance with annex E, the tape shall not break, or tear or split at the crests of the thread form, and the finishing end of the tape shall remain in position with no tendency to unwind.

9 Sealing tests

Any sample of tape shall form a leak-free seal when tested as specified in the relevant British, European or international application standard. In the absence of such a standard, the manufacturer shall supply tape in accordance with 3.2a, that provides a safe leak-free seal which provides the agreed performance for the intended application when applied to a joint or joints of representative size and thread form. Unless otherwise agreed in accordance with 3.2f, the joint(s) shall be tested at a pressure or vacuum as follows:

- a) for pressure, 1.5 times the maximum required working pressure; and
- b) for vacuum, 1.0 times vacuum;

over the expected working temperature range.

NOTE. The chosen pressure medium may be the actual flow product, or the joint may be exposed to the flow product, or agreed simulant, prior to pressure testing with compressed air or nitrogen gas.

10 Sampling

All samples of tape used for the tests specified in clauses 4, 5, 8 and 9 shall be taken from a wound spool omitting the first layer or wrapping.

11 Packaging and marking

11.1 Tape shall be wound onto spools which have a close fitting sleeve capable of excluding dust and grit. Spool and sleeve shall be resistant to mechanical damage in normal handling and usage.

11.2 Each spool of tape shall be indelibly and legibly marked with the following information:

- | a) the manufacturer's or supplier's name or trade mark;
- | b) the number and year of this British Standard and the grade of tape, e.g. BS 7786 : 1995²⁾: Grade M;
- | c) the nominal length, the width and the thickness of the tape;
- | d) 'NOT FOR OXYGEN USE', if the residual lubricant level exceeds 0.1 %;
- | e) whether or not the tape is suitable for potable water.

²⁾Marking BS 7786 : 1995 on or in relation to a product represents a manufacturer's declaration of conformity, i.e. a claim by or on behalf of the manufacturer that the product meets the requirements of the standard. The accuracy of the claim is solely the claimant's responsibility. Such a declaration is not to be confused with third party certification of conformity, which may also be desirable.

Annexes

Annex A (normative)

Determination of residual lubricant content

A.1 Principle

The residual lubricant content is determined from the loss in mass of a sample after extraction with petroleum spirit and subsequent heating at 300 °C.

A.2 Reagent

Petroleum spirit (boiling range 40 °C to 60 °C). The solvent used for this extraction shall be of a general purpose laboratory reagent quality.

WARNING. Petroleum spirit is highly flammable. Take precautions to avoid ignition. Avoid breathing the vapour and contact of the petroleum spirit with skin or eyes. Refer to the supplier's health and safety data for the precautions which are to be taken for the safe use of petroleum spirit.

NOTE. Attention is drawn to the Control of Substances Hazardous to Health (COSHH) Regulations 1988 [1].

A.3 Apparatus

A.3.1 Soxhlet extractor, conforming to BS 2071 : 1989 with a nominal capacity of 100 ml. The socket joint shall be of 34/35 size, as specified in BS 572 : 1985, the cone joint shall be of 24/29 size, as specified in BS 572 : 1985, and the extraction thimble fitted with a fritted glass plate shall conform to BS 1752 : 1983 with a maximum pore diameter within the range 100 µm to 160 µm.

NOTE. Suitable sizes of extraction thimble and condenser are given in annex A of BS 2071.

A.3.2 Condenser

A.3.3 Boiling flask, with conical ground glass joint of size 29/32, conforming to BS 6352 : 1983.

A.3.4 Air circulation oven, capable of being maintained at a temperature of 100 °C ± 5 °C and 300 °C ± 5 °C.

A.3.5 Metal crucible

A.3.6 Balance, of sufficient capacity to weigh the metal crucible and its contents to an accuracy of 0.1 mg.

A.3.7 Desiccator

A.4 Procedure

A.4.1 Extraction

Clean, dry and weigh the extraction thimble fitted with the fritted glass plate (A.3.1) to the nearest 0.1 mg using the balance (A.3.6).

Cut approximately 15 g of the tape sample (see clause 10). Place the tape into the extraction thimble fitted with the fritted glass plate and weigh to the nearest 0.1 mg.

Insert the extraction thimble fitted with the fritted glass plate and tape, into the Soxhlet extractor (A.3.1). Pour 300 ml to 400 ml of petroleum spirit (A.2) into the boiling flask (A.3.3). Assemble the boiling flask, Soxhlet extractor and condenser (A.3.2) and subject the tape to at least 60 extractions during a continuous period of not less than 4 h. After the extraction is completed, remove the thimble from the apparatus and dry in an air circulation oven (A.3.4) maintained at 100 °C ± 5 °C.

A.4.2 Heating

Clean, dry and weigh the metal crucible (A.3.5) using the balance (A.3.6). Transfer the extracted tape from the thimble to the metal crucible and place them in the air circulation oven (A.3.4) at 300 °C ± 5 °C for 6 h. At the end of this period remove the metal crucible from the oven and cool in the desiccator (A.3.7). Remove the metal crucible from the desiccator and using the balance weigh the crucible and tape.

A.5 Expression of results

The percentage residual lubricant content c (% (m/m)) is given by the equation:

$$c = (m_1 - m_2) \times \frac{100}{m_1}$$

where

m_1 is the original mass of the tape;

m_2 is the mass of the tape after the extraction and heating treatments.

Calculate and report the percentage residual lubricant content, to the nearest 0.01 %.

Annex B (informative)

Explanatory note

Since the publication of BS 4375 : 1968 technical advances have been made in PTFE tape manufacture such that tapes can now be produced with varying micro-void contents by hot stretching techniques. The stretching process allows the production of tapes with densities commonly in the range 0.3 g/ml to 1.6 g/ml (full density). Lower density tapes generally exhibit improved conformability, drapeability, joint cohesion, and the ability to seal fine threads.

However, sealing performance depends primarily upon the mass per unit area which gives a measure of the fully compressed thickness available at the sealing interface. Low density tapes will require more wraps than higher density products to effect a given seal.

Specifying only a preferred thickness does not in itself fully characterize the properties of the tape except in the special case where no stretching has been performed, i.e. full density tape, 1.5 g/ml to 1.7 g/ml.

9

In order to fully characterize the properties of the tape, it is necessary that at least two of the following parameters are known:

- a) thickness;
- b) density; or
- c) mass per unit area.

The mass per unit area m/a (g/m^2) is given by the equation:

$$\frac{m}{a} = 1000 \times t \times \rho$$

where

- m is the mass (g);
- a is the unit area (m^2);
- t is the thickness (mm);
- ρ is the density (g/ml).

This standard allows three grades of tape to be designated according to their range of mass per unit area. The lowest bound of 25 g/m^2 is set to exclude lightweight tapes which are unlikely to seal even the finest threads unless used in multiple wraps. The highest bound is set either by the maximum attainable density for unsintered tapes of 1.5 g/ml to 1.7 g/ml or by the mass per unit area set by this specification of 300 g/m^2 , a value which is seldom exceeded in thread sealing applications.

Figure B.1 shows the theoretical relation between mass per unit area and density and the bounds allowed by this specification (see bounded area).

Within any given grade the mass per unit area can be attained by various combinations of thickness and density. This allows the manufacturer and purchaser to specify the optimum thickness and density best suited for the particular application. The full lines show the mass per unit area/density relationships for the preferred thickness values.

10

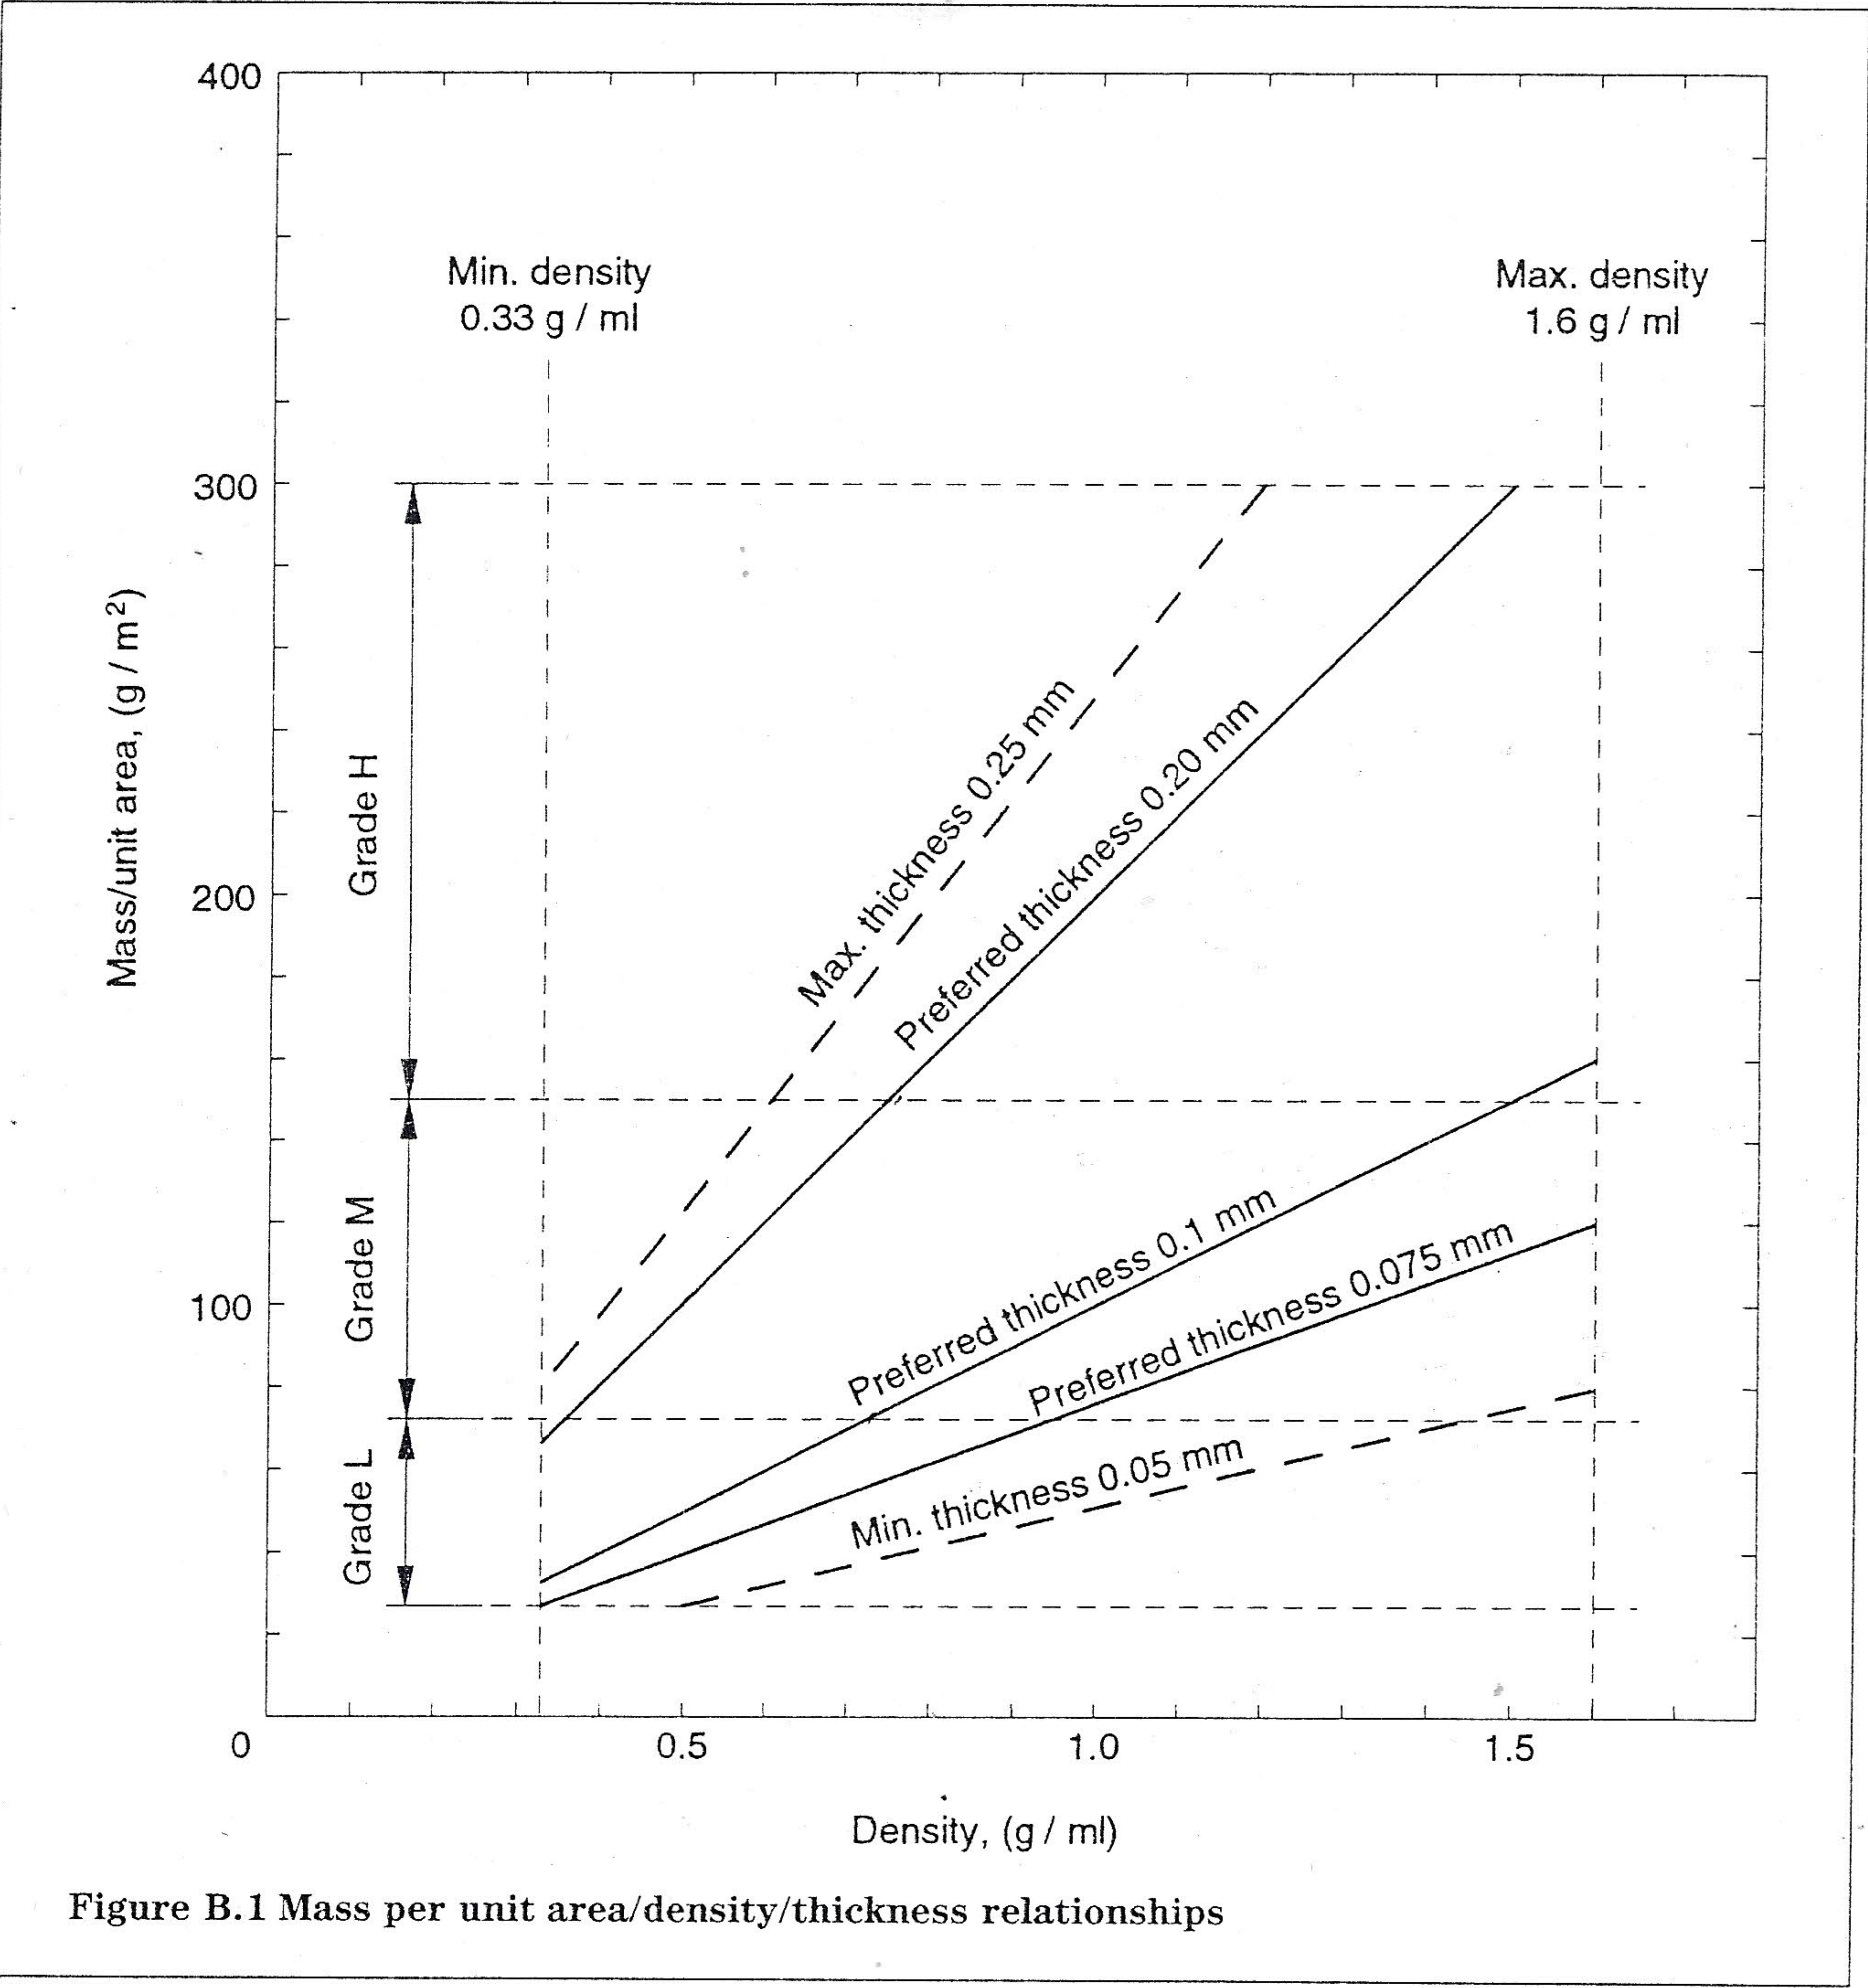


Figure B.1 Mass per unit area/density/thickness relationships

11

Annex C (normative)

Determination of mass per unit area

C.1 Apparatus

C.1.1 *Balance*, capable of measuring to ± 5 mg.

C.2 Procedure

After the measurement of width, thickness and length (see clause 7) weigh the full length of tape removed from the spool to the nearest 5 mg.

C.3 Expression of result

Calculate the mass per unit area, M_a (in g/m^2) from the following equation:

$$M_a = 1000 \times \frac{m}{wL}$$

where

m is the mass of PTFE on the spool (in g);

w is the average width (in mm);

L is the length (in m).

Annex D (normative)

Measurement of tape dimensions

D.1 Apparatus

D.1.1 *Metre rule*, for measuring lengths of 1 m to an accuracy of ± 0.5 mm.

D.1.2 *Graticule*, for measuring lengths of 10 mm to 25 mm to an accuracy of ± 0.1 mm.

D.1.3 *Micrometer gauge*, capable of reading to an accuracy of 0.0025 mm and having a foot of not less than 6.3 mm in diameter. The micrometer shall apply a pressure at the foot of between 10 kPa and 20 kPa when used for measuring the thickness of the tape.

D.2 Procedure

D.2.1 Lay the tape out free from tension in close contact along its length with a flat surface. Measure the length of tape on the spool, in metres, to an accuracy of ± 0.5 mm, using the metre rule (D.1.1).

D.2.2 Determine the width of the tape, in mm, using the graticule (D.1.2), to an accuracy of ± 0.1 mm at points approximately 50 mm from each end and at a minimum of three other points at equal distances between the first two readings. Take the mean value of the readings as the width of the tape.

D.2.3 Take readings of the thickness of the tape, in mm, using the micrometer gauge (D.1.3) at points approximately 50 mm from each end of the tape and at a minimum of three other points at equal distances between the first two readings. Take the mean value of the readings as the thickness of the tape.

D.3 Test report

Record the following in the test report:

- the length of the tape on the spool in metres;
- the width of the tape in millimetres; and
- the thickness of the tape sample in millimetres.

Annex E (normative)

Thread wrapping test

E.1 Apparatus

E.1.1 *Pipe*, of approximately 150 mm length, with a wall thickness which exceeds 2 mm, machine cut at one end with a taper thread conforming to BS 21 : 1985, of size and material as specified in the appropriate application standard. Where no application standard applies, the size and material shall be as agreed between the purchaser and the manufacturer in accordance with 3.2e.

E.2 Procedure

E.2.1 Wind a length of the tape sample round the thread by hand, in a clockwise direction when viewed from the open end of the pipe, to give a double layer covering, using a constant, minimal tension sufficient for the tape to take up the form of the thread. The tape width shall not exceed the length of the thread form.

E.2.2 Where the length of the thread form exceeds the tape width apply the tape in helical fashion, in the same clockwise direction, but with a 50 % overlap as shown in figure E.1.

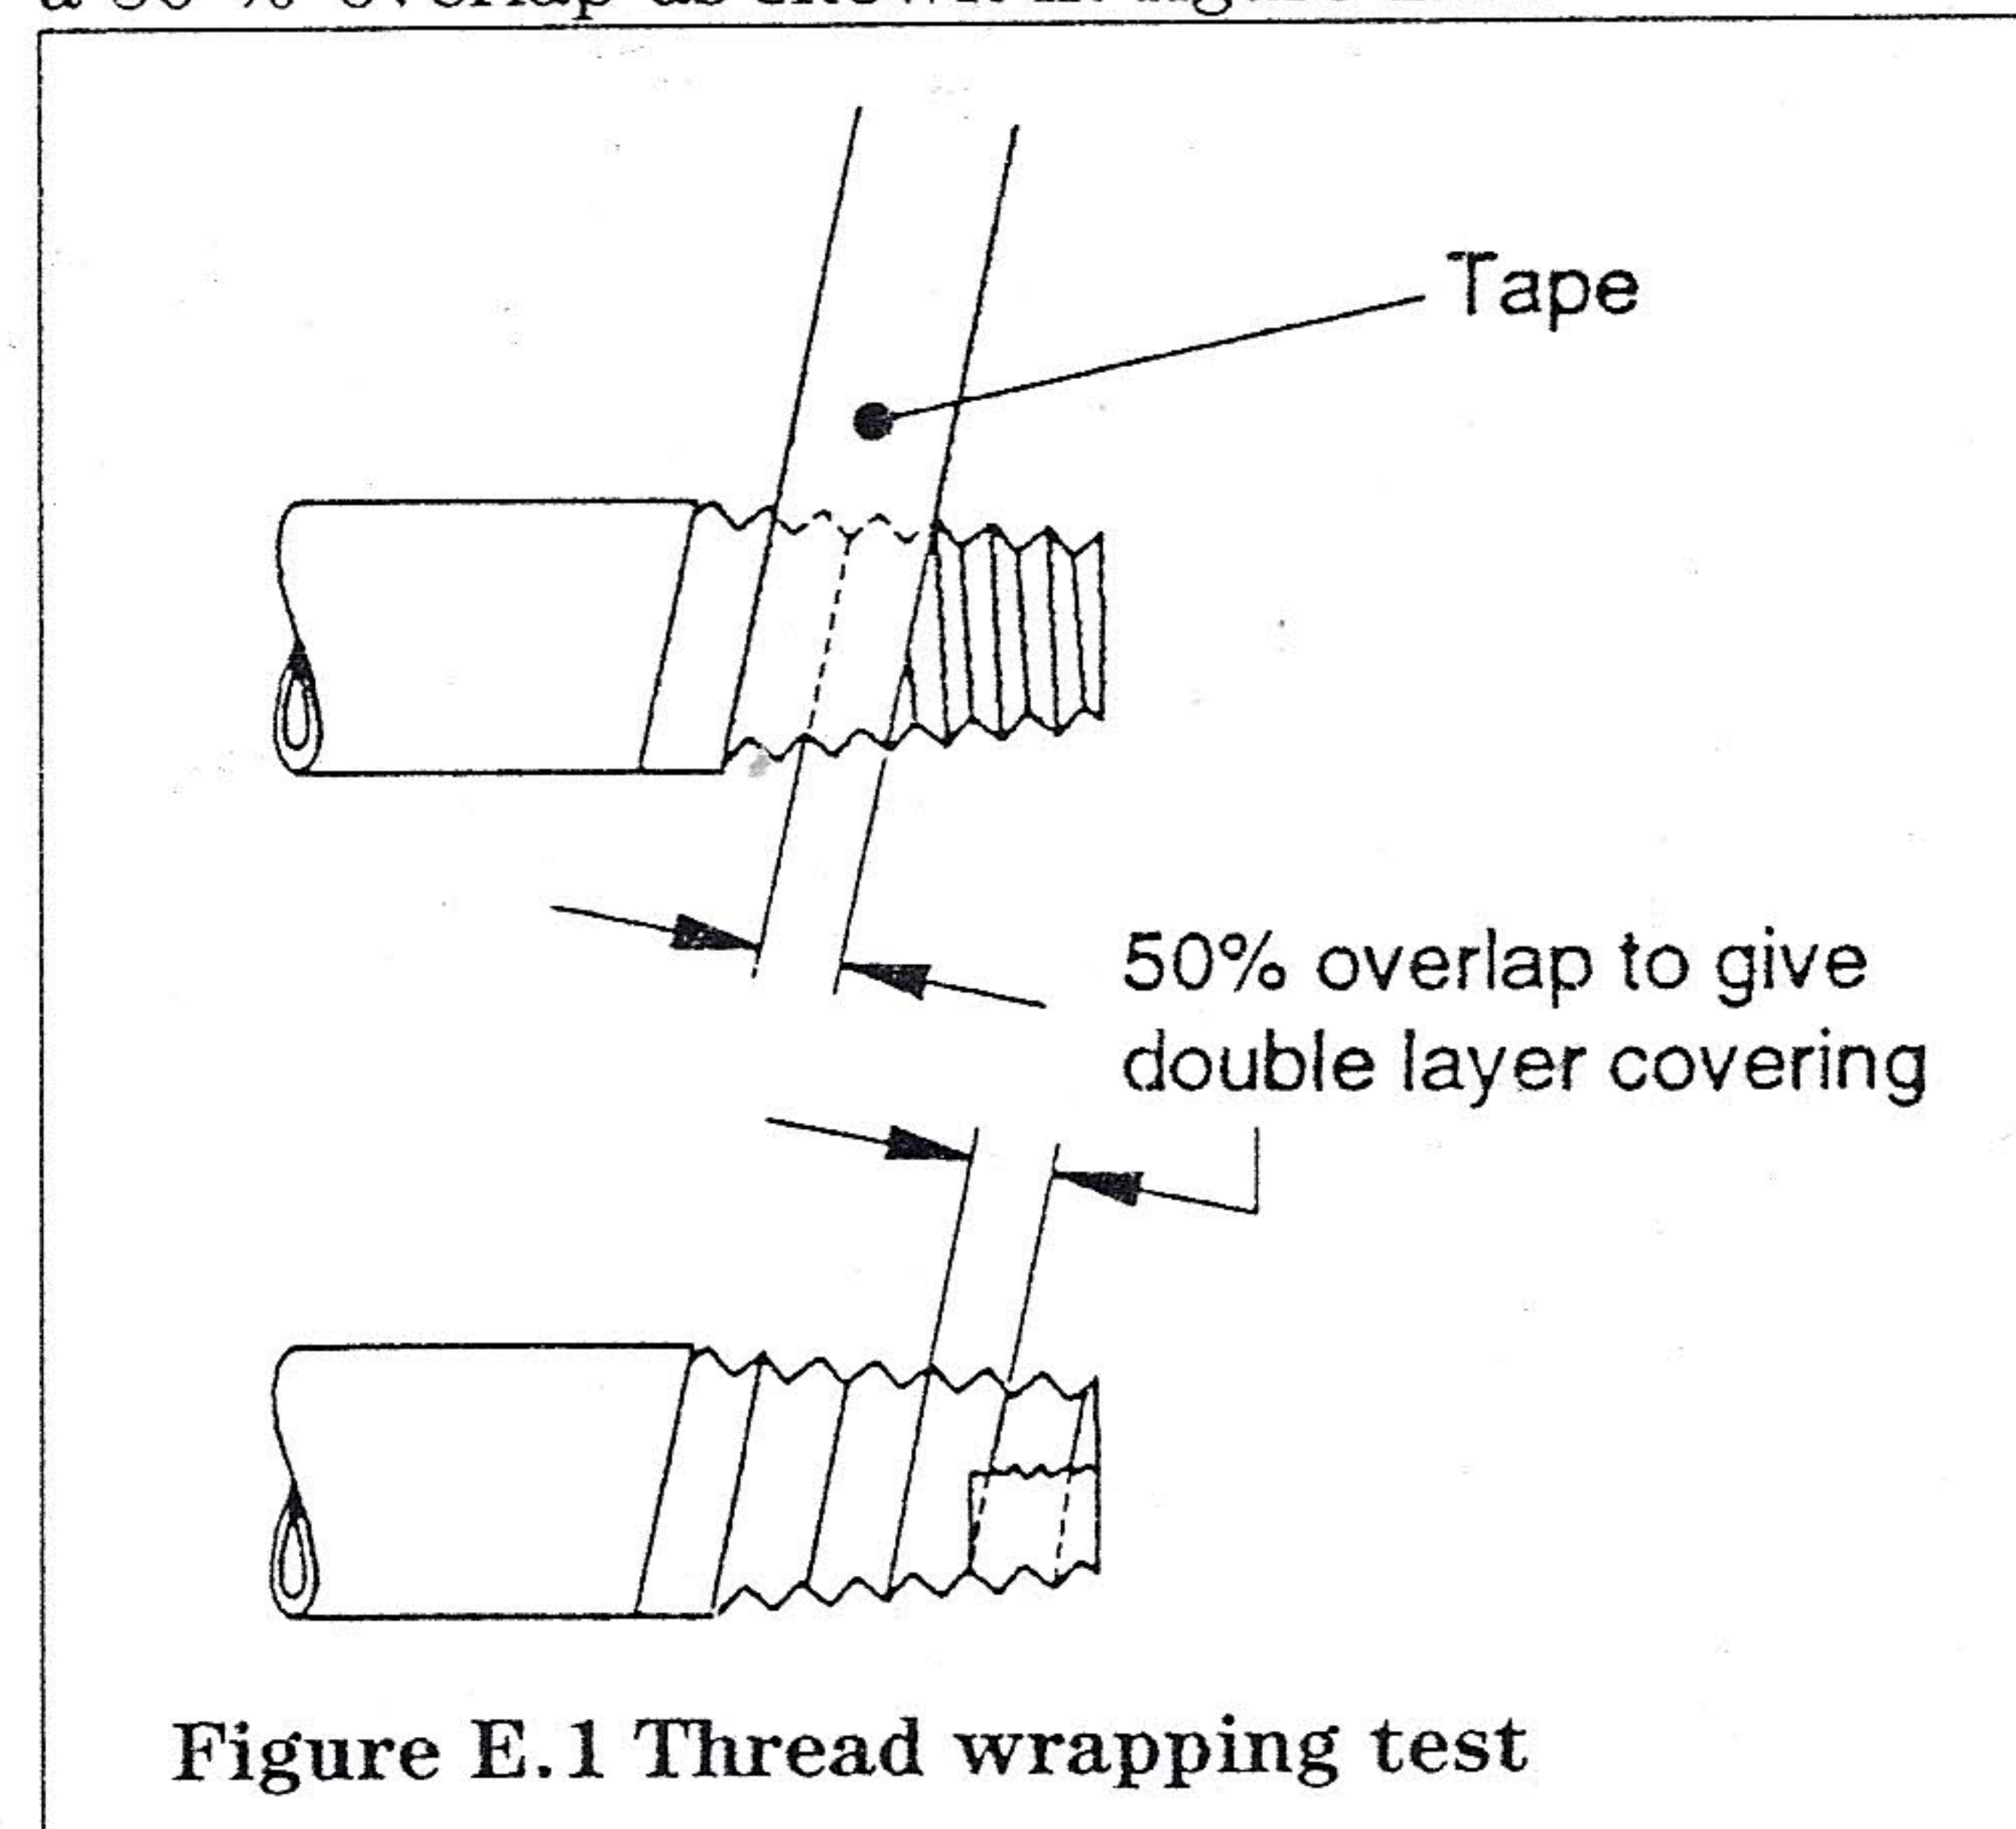


Figure E.1 Thread wrapping test

E.3 Test report

Record the following in the test report:

- whether or not the tape has taken up the form of the thread;
- whether or not the finishing end of the tape remains in position;
- whether or not the tape has broken, or torn or split at the crests of the thread form.

List of references (see clause 2)

(12)

Normative references

BSI publications

BRITISH STANDARDS INSTITUTION, London

- | | |
|------------------------------|--|
| BS 21 : 1985 | <i>Specification for pipe threads for tubes and fittings where pressure-tight joints are made on the threads (metric dimensions)</i> |
| BS 572 : 1985 | <i>Specification for interchangeable conical ground glass joints</i> |
| BS 1752 : 1983 | <i>Specification for laboratory sintered or fritted filters including porosity grading</i> |
| BS 2071 : 1989 | <i>Specification for Soxhlet extractors</i> |
| BS 6352 : 1983 | <i>Specification for flasks with ground glass joints</i> |
| BS 6564 : | <i>Polytetrafluoroethylene (PTFE) materials and products</i> |
| BS 6564 : Part 1 : | <i>Polytetrafluoroethylene powders for moulding and extrusion</i> |
| BS 6564 : Section 1.2 : 1989 | <i>Method of specifying</i> |
| BS 6920 : | <i>Suitability of non-metallic products for use in contact with water intended for human consumption with regard to their effect on the quality of the water</i> |
| BS 6920 : Part 1 : 1990 | <i>Specification</i> |

Other references

AMERICAN SOCIETY FOR TESTING AND MATERIALS, Philadelphia

- | | |
|----------------|--|
| ASTM D 4591-93 | <i>Standard test method for determining temperatures and heats of transitions of fluoropolymers by differential scanning calorimetry</i> |
|----------------|--|

Informative references

BSI publications

BRITISH STANDARDS INSTITUTION, London

- | | |
|----------------|--|
| BS 6974 : 1991 | <i>Specification for unsintered PTFE tape for thread sealing applications (coarse threads)</i> |
|----------------|--|

Other references

DEUTSCHE INSTITUT FÜR NORMUNG

- | | |
|-----------|---|
| DIN 30660 | <i>Jointing material for gas and water supplies and for hot water installations</i> |
|-----------|---|

[1] GREAT BRITAIN. Control of Substances Hazardous to Health Regulations, 1988. London: HMSO

BSI — British Standards Institution

13

BSI is the independent national body responsible for preparing British Standards. It presents the UK view on standards in Europe and at the international level. It is incorporated by Royal Charter.

Contract requirements

A British Standard does not purport to include all the necessary provisions of a contract. Users of British Standards are responsible for their correct application.

Revisions

British Standards are updated by amendment or revision. Users of British Standards should make sure that they possess the latest amendments or editions.

Any person who finds an inaccuracy or ambiguity while using this British Standard should bring it to the attention of the Quality Manager, BSI without delay so that the matter may be investigated swiftly.

BSI offers members an individual updating service called PLUS which ensures that subscribers automatically receive the latest editions of standards.

Buying standards

Orders for all BSI, international and foreign standards publications should be addressed to Customer Services, Sales Department at Chiswick:
Tel: 0181 996 7000; Fax: 0181 996 7001.

In response to orders for international standards, it is BSI policy to supply the BSI implementation of those that have been published as British Standards, unless otherwise requested.

Information on standards

BSI provides a wide range of information on national, European and international standards through its Library, the Standardline Database, the BSI Information Technology Service (BITS) and its Technical Help to Exporters Service. Contact the Information Department at Chiswick:
Tel: 0181 996 7111; Fax: 0181 996 7048.

Subscribing members of BSI are kept up to date with standards developments and receive substantial discounts on the purchase price of standards. For details of these and other benefits contact Customer Services, Membership at Chiswick: Tel: 0181 996 7002; Fax: 0181 996 7001.

Copyright

Copyright subsists in all BSI publications and no part may be reproduced in any form without the prior permission in writing of BSI. This does not preclude the free use, in the course of implementing the standard of necessary details such as symbols and size, type or grade designations including use by incorporation into computer programs, but where these details are reproduced including without limitation in printed form, in computer programs or in any other form whatsoever, the permission in writing of BSI must be obtained and if granted will be on terms including royalty, before the product is sold, licensed or otherwise exploited for commercial gain. Enquiries about copyright should be made to the Copyright Manager at Chiswick.

P R O D U C T I N F O R M A T I O N

PRODUCT REFERENCE: Gas Tape PTFE Thread Seal Tape

DESCRIPTION: A Premium grade Thread Seal Tape, of nominal thickness 0.2mm and density 0.8-0.9 g/cc, manufactured from 100% pure, virgin PTFE and containing less than 0.1% residual lubricant.

SERVICE: Gas Thread Seal Tape is resistant to attack by all acids, alkalis, solvents and chemicals over a wide operating temperature range of -240 to +260°C. It is suitable for use on pipelines of any material up to 50mm nominal bore (one wrap) or 100mm nominal bore (two wraps) with taper/taper or taper/parallel threaded connections.

Gas Tape PTFE has been specially formulated for use with natural gas, town gas, butane, propane and satisfies BS.5292 Type C tests, BGC IM/16, BS.6974 and is approved by the AGA (No. 4383).

The working pressures contained will depend on the size and quality of threads and fittings, and the service temperature.

A 50mm taper/parallel combination with BS.21 threads will withstand a gas test pressure of 80 bar. Any similar combination up to 100mm bore will withstand saturated steam up to 15 bar (202°C).

AVAILABILITY: Available in 5 metre lengths, wound on spools with protective sleeves, in 12, 19 and 25mm widths.

HEALTH & SAFETY: Thread Seal Tapes contain PTFE. They should be handled in accordance with the safety precautions detailed in our Health and Safety Bulletin, Sections 1,2, 2.10.

20 July 1994